

	
	YW-20190404-001
	2019-04-04
IM267	1
	15

IM267

IM267

: 135 7383 0623

QQ:1774880258

RV2025

2755

<http://www.jnrovin.com>





		
		YW-20190404-001
IM267		2019-04-04
		4 15
		20.4-28.8V DC
		2A
		500V
5V DC		1500mA
x x		71 x 80 x 62

1.4

IP


1.5

IM267IM267GSDMLIM 267GSDML“ PROFINET

IM267GSDML”IM267

PROFINETS7-200I/OIM267LAN

PROFINET

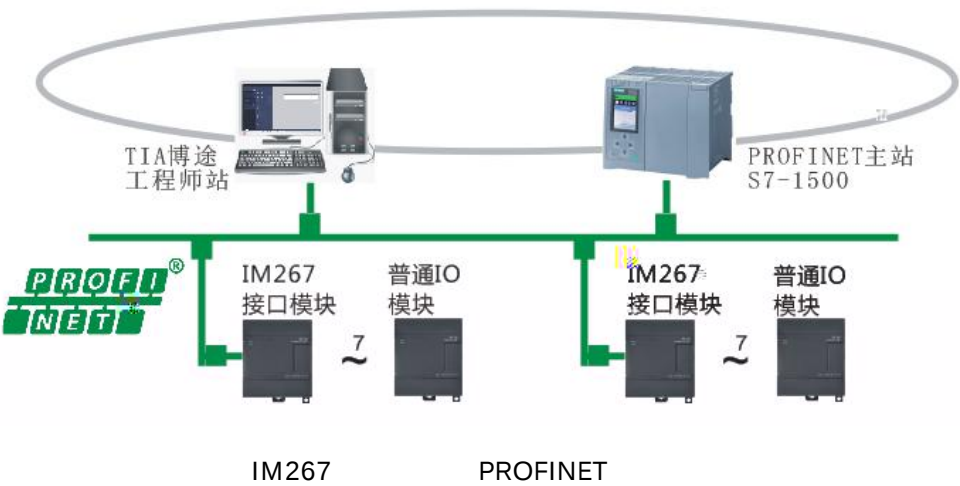

	
	YW-20190404-001
IM267	2019-04-04
	5 15

1.6 LED

IM267LED

	0/	_____	
	,	,	

2TIAV15IM267

IM267S7-1215CPROFINETCPU

1200IM267I/O TIA Portal V15

2.1

IM267

S7-1200CPU

200222-1PL22 + 222-1HH22 + 232-0HD22 + 231-7PC22

PROFINET

2.2

2.2.1

1TIA Portal1200







YW-20190404-001


IM267



	
	YW-20190404-001
IM267	2019-04-04
	7 15

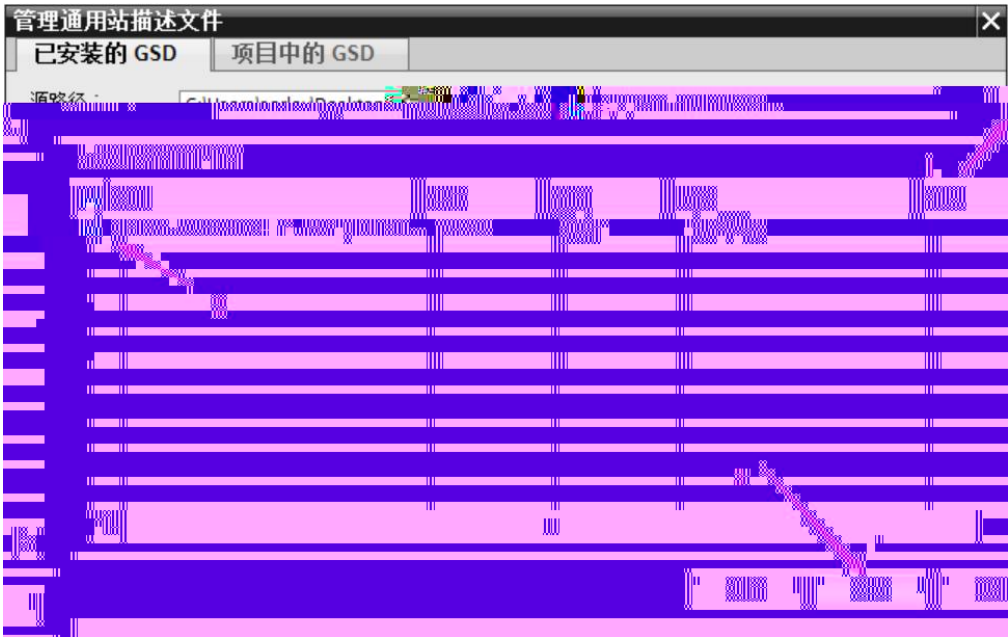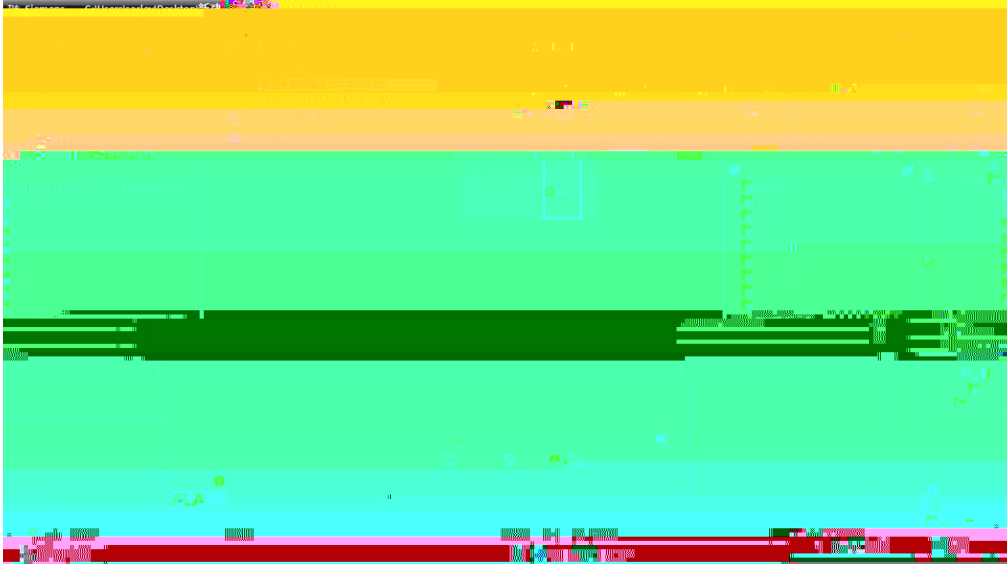

		
	YW-20190404-001	
IM267	2019-04-04	
	8	15

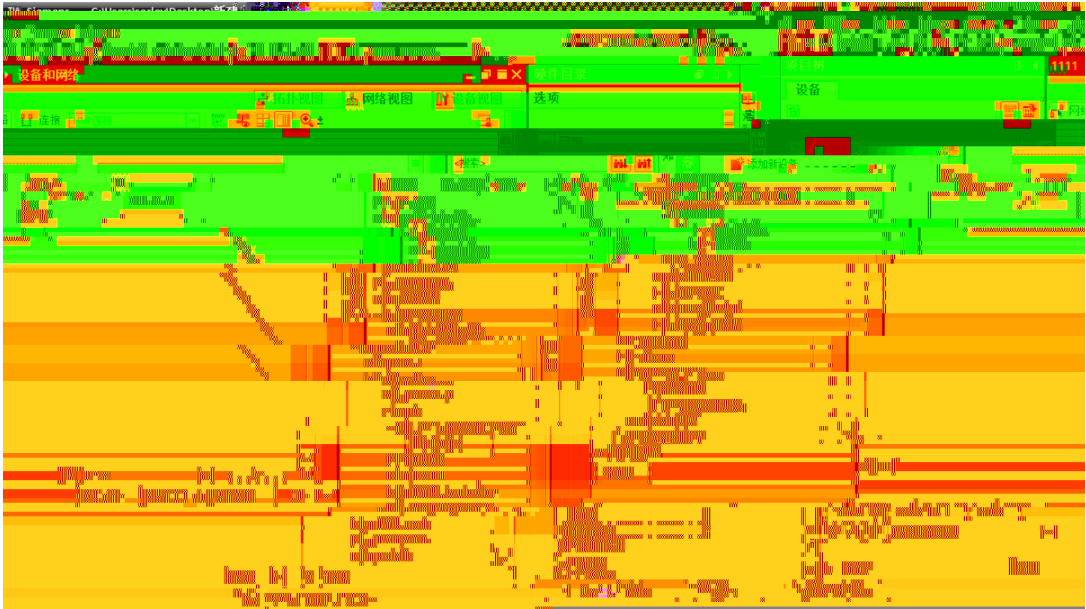

4


PLC

IM267


PN/IE_1

IP

		
	YW-20190404-001	
	2019-04-04	
IM267	9	15

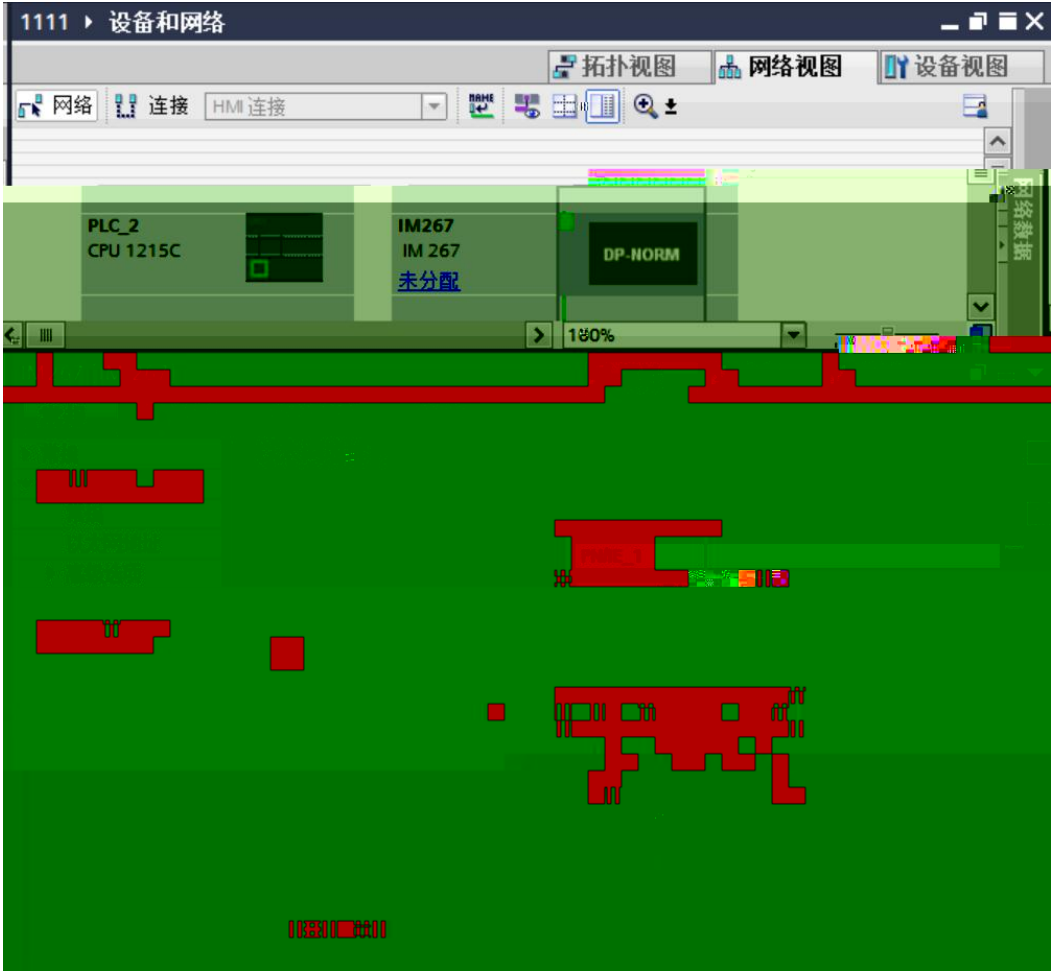

CPU ,

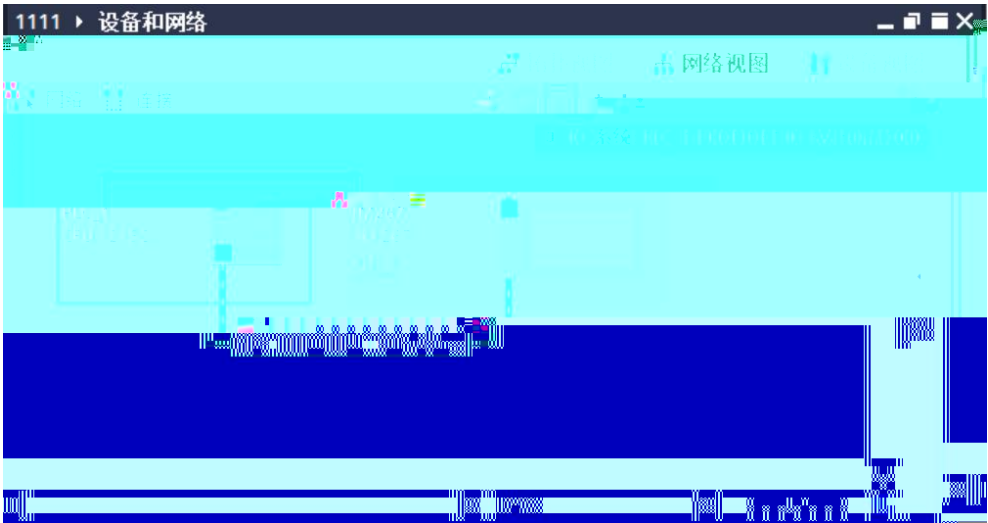

		
	YW-20190404-001	
IM267	2019-04-04	
	10	15

5



6 IM267 IP 4 267 IP

IP IM267- -

IM267






		
	YW-20190404-001	
IM267	2019-04-04	
	12	15

8

CPU

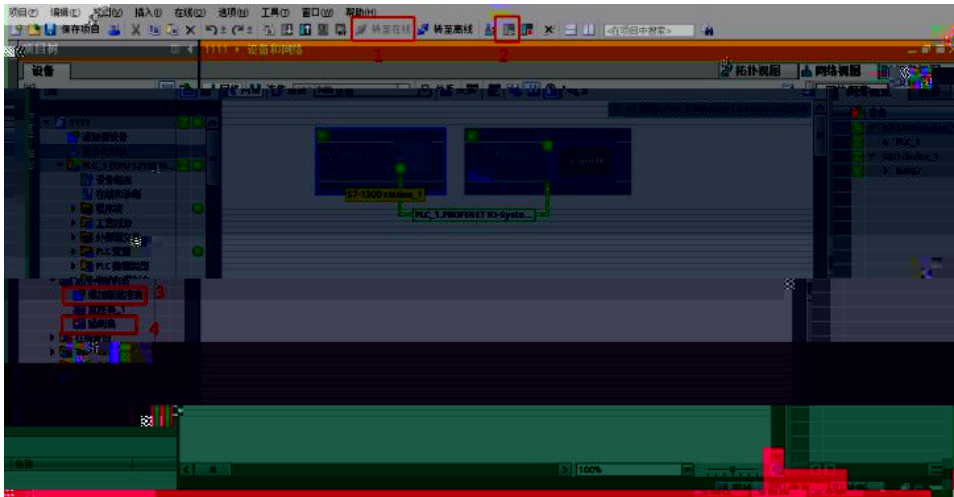

9

QW10,QW14 16000


5V,10mA

IW42

10


200PLC

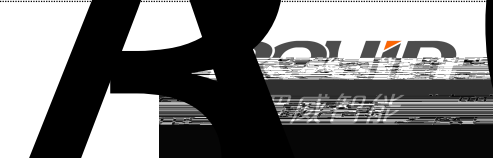

		
		20190404-001
IM267		19-04-04

B

		
	YW-20190404-001	
	2019-04-04	
IM267	15	15

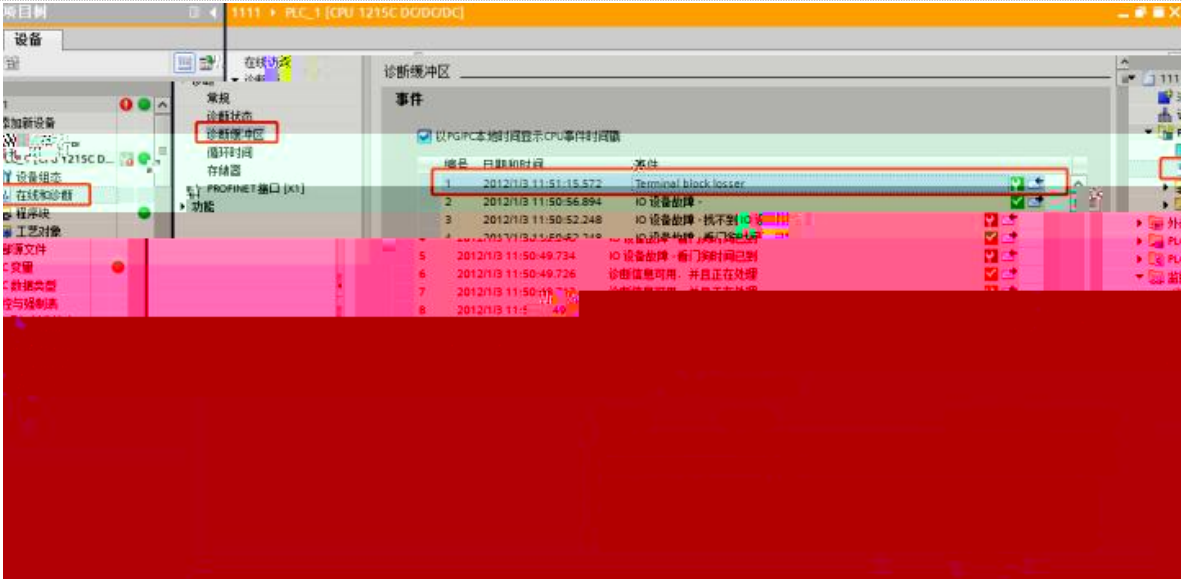

- Terminal block loss——
- Blown fuse Err——
- No user power Err——
- Out of-range Err——
- Bus Fault or parity err——
- Config Mask——

4

IM267

